


FINISHED SUBGRADE OR ORIGINAL GROUND SURFACE. SEE APPROPRIATE DETAIL FOR SURFACE RESTORATION

MOUND 4" IN UNIMPROVED AREAS

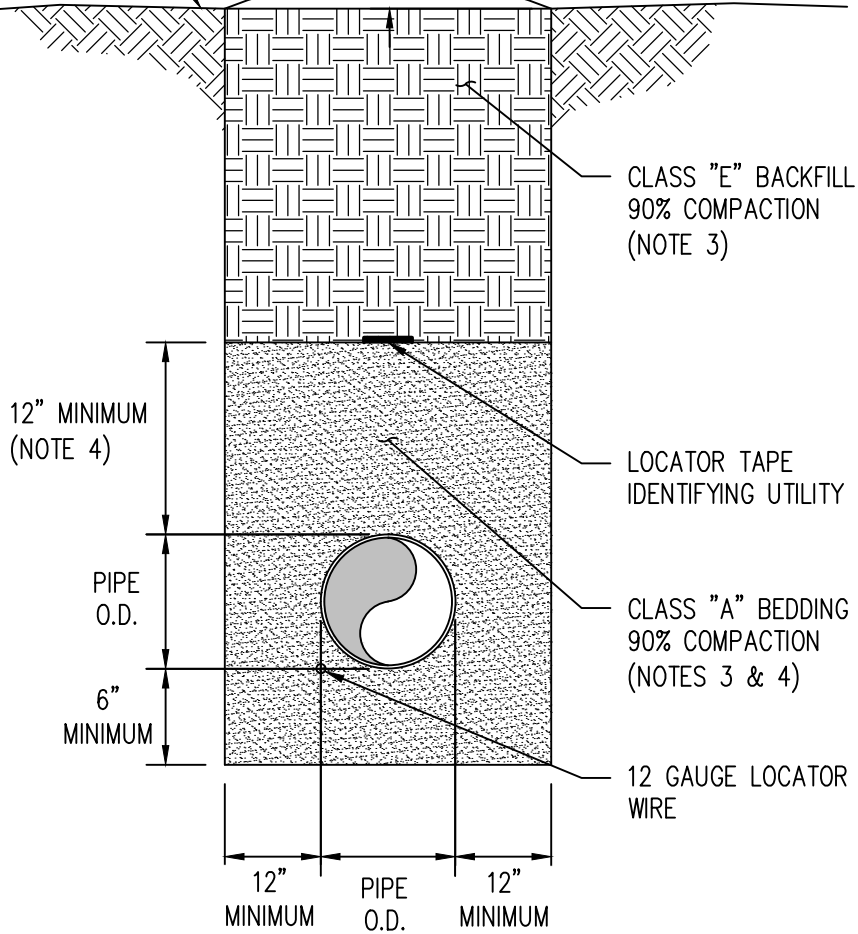

NOTES:

1. ALL MATERIALS AND INSTALLATION PROCEDURES SHALL BE IN ACCORDANCE WITH "STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION," (SSPWC) LATEST EDITION.
2. ALL TRENCHING ACTIVITIES SHALL CONFORM TO O.S.H.A. REGULATIONS.
3. COMPACTION SHALL BE 90 PERCENT RELATIVE COMPACTION BASED ON THE MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D1557 AND WITHIN $\pm 2\%$ OF OPTIMUM MOISTURE CONTENT.
4. IN HIGH GROUNDWATER, CLASS "C" BEDDING TO HIGH GROUNDWATER MARK TOPPED WITH MIRAFI 140N FILTER FABRIC, OR APPROVED EQUAL, MAY BE USED IN LIEU OF CLASS "A", WITH THE APPROVAL OF THE ENGINEER.

DATE	REVISIONS



STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION
TRENCH DETAIL
WATER

SECTION NUMBER: 300
DRAWING NUMBER: W-302
DATE: 2/21/2022